

ANTİGRİZU BAĞLANTI KUTULARI FIRE DAMP JUNCTION BOXES

Sınıflandırma / Classification

IM2 Ex d I Mb



Standartlar / Standards

EN 60079-0 / EN 60079-1 / EN 60079-31

Sertifika No. / Certificate No.

SCA 13 ATEX 057X / ALSz (M) 11.0244 / TSE 14.31.35-EX/173

AGUFX

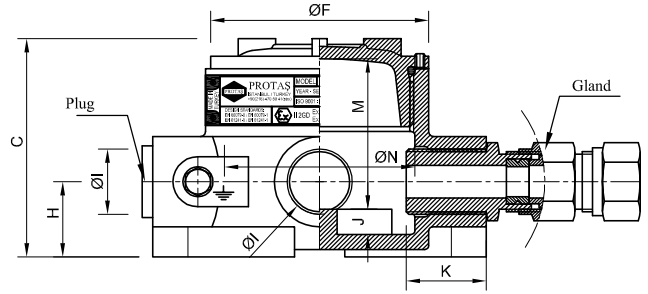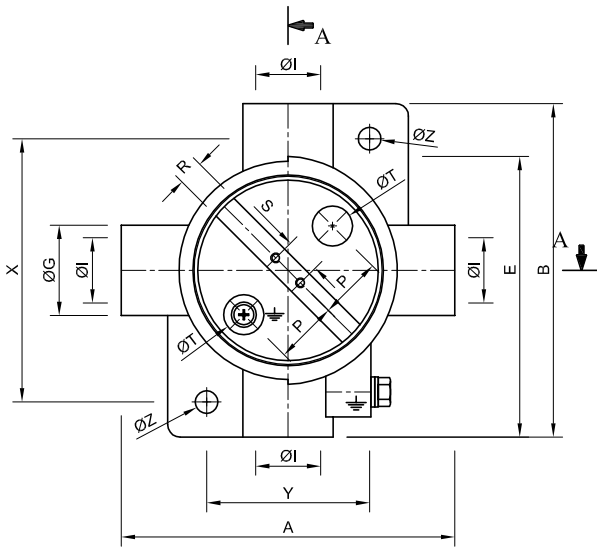

SECTION A-A

Model	Ölçüler / Dimensions (mm)																			Topraklama Earthing		
	A	B	C	E	ØF	ØG	H	ØI	J	Kmax.	M	ØN	P	R	S	ØT	X	Y	ØZ	İç In	Dış Out	
AGUFX.26	133	133	87	112	87	36	30	3/4"	10	35	60	76	25	10	22	M3	16	105	65	9	M4	M6

Malzeme: Pisk döküm GG20 / Material: Cast Iron GG20

Ortalama ağırlık: 0.8 kg / Approximate weight: 0.8 kg

www.protas.com.tr